

APP CRS 278°	Rwy Idg TDZE Apt Elev	5457 7 9
------------------------	-----------------------------	-------------------------------------


RNAV (RNP) Z RWY 28R
METRO OAKLAND INTL (OAK)

T For uncompensated Baro-VNAV systems, procedure NA below 1°C (34°F) or above 54°C (130°F). For inop MALSR, increase RNP 0.11 DA all Cats visibility to RVR 4500. GPS required.

MALSR

MISSED APPROACH: Climb to 3000 on track 278° to ZERMO and on track 335° to REBAS and hold.

D-ATIS 133.775	NORCAL APP CON 125.35 263.15	OAKLAND TOWER 118.3 291.65 (Rwys 10L/R-28L/R, 15-33) 127.2 256.9 (Rwy 12-30)	GND CON 121.9 (Rwys 10L/R-28L/R, 15-33) 121.75 (Rwy 12-30)	CLNC DEL 121.1	CPDLC
--------------------------	--	--	--	--------------------------	-------

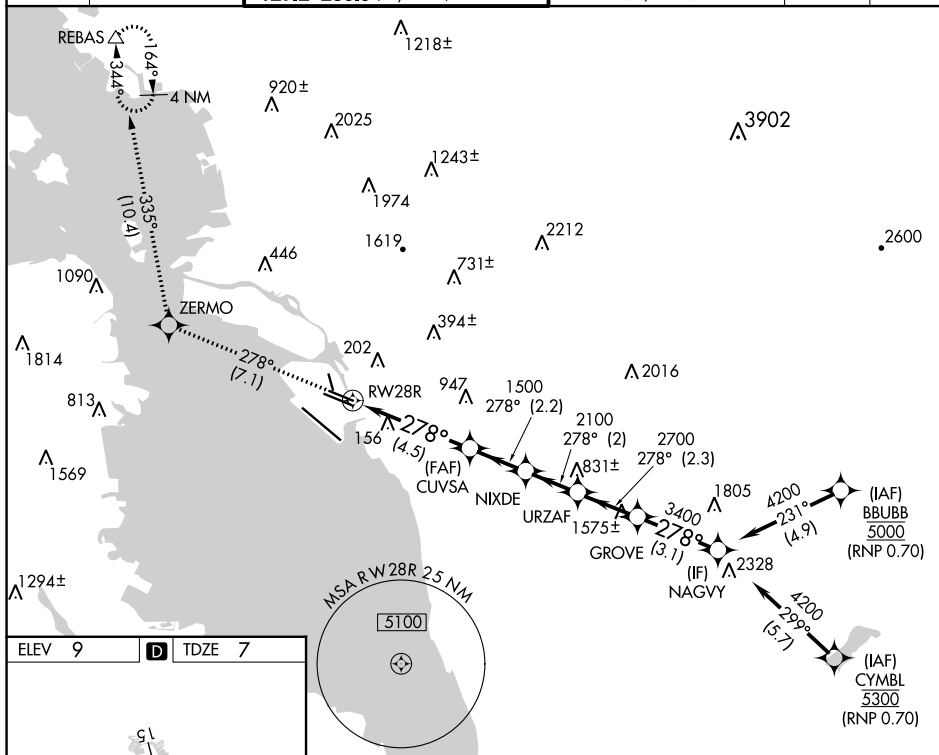

3000	ZERMO	REBAS
tr 278°	tr 335°	△

CUVSA 1500
NIXDE 2100
URZAF 2700
GROVE 3400
NAGVY 4200

GP 3.00°
TCH 53°

CATEGORY	A	B	C	D
RNP 0.11 DA	276/24	269 (300-1/2)		
RNP 0.30 DA	414/45	407 (500-7/8)		

AUTHORIZATION REQUIRED